

Potenza pompa
 1.1KW 3~230V 50Hz
 Pump power supply
 1.1KW 3~230V 50Hz

XQ

REV.	MODIFICA	DATA	FIRMA	APPR.	LB	SOST. IL :	SOST. DA :	FILE : QCFH19-3G	L.C.Z. - Parma - CFH400-12bar Potenza pompa Power pump	QCFH19-3G	=	FG 7
0												
		02/11										
				DISEGN.	LB							
				VISTO	LB							



L.C.Z. srl
Parma ITALY


QCFH19-3G

SS990

FG
7

F.S.
8

Controllo massima
temperatura fumi
Temperature flue
controller

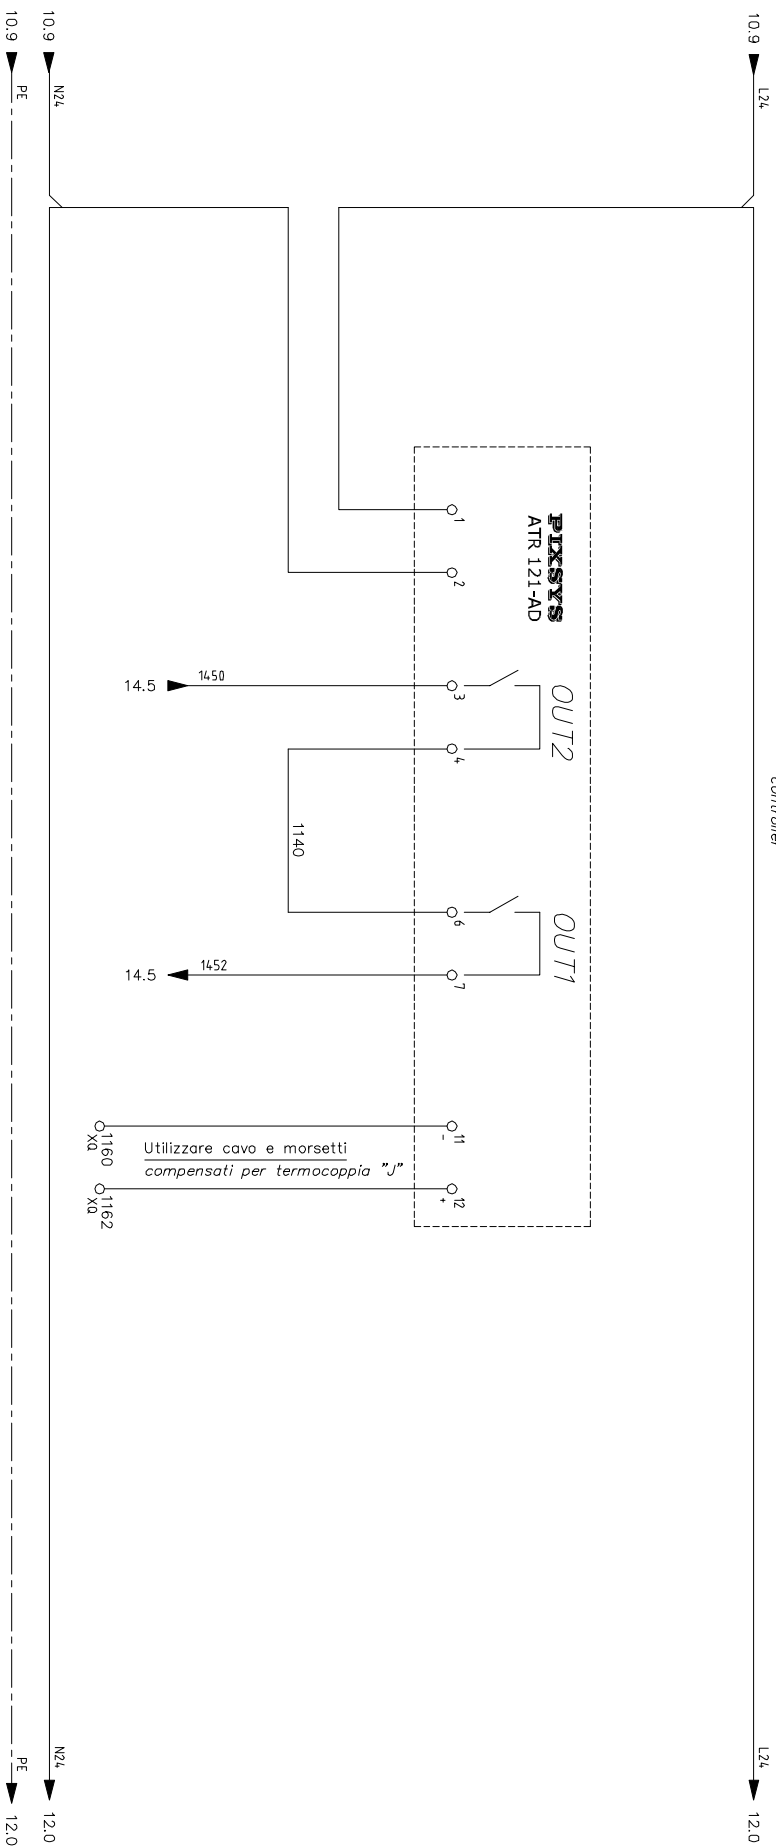


Termocoppia
tipo J
Flue
thermocouple J

REV.	MODIFICA	DATA	FIRMA	APPR.	LB	SOST. IL :	SOST. DA :	FILE : QCFH19-3G	L.C.Z. srl Parma ITALY	L.C.Z. -Parma- CFH400-12bar Controllo temperatura fumi Temperature flue controller	QCFH19-3G	=	SS990	FG 11 FS 12
0														
		02/11												
		DISEGN												
		LB												
		VISTO												
		LB												



Controllo massima
temperatura serpentino
*Coil temperature
controller*

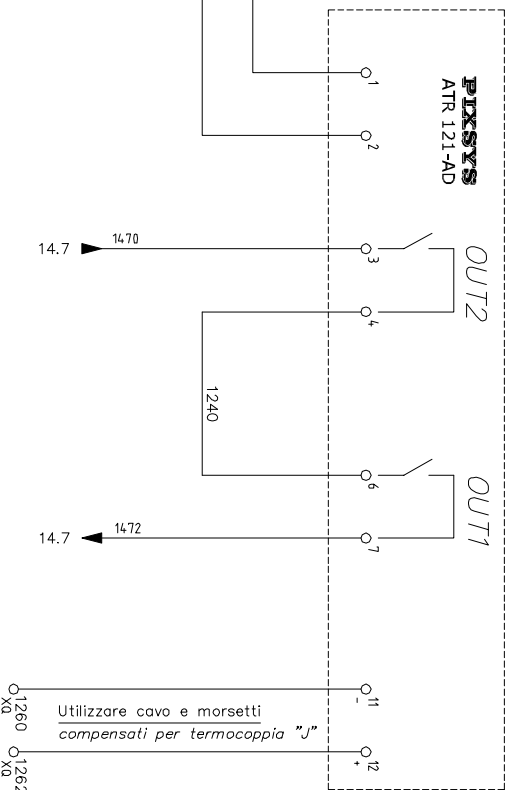


XQ

Termocoppia
tipo J
*Coil
thermocouple J*

REV.	MODIFICA	DATA	FIRMA	APPR.	LB	SOST. IL :	SOST. DA :	FILE : QCFH19-3G	L.C.Z. srl Parma ITALY	L.C.Z. -Parma- CFH400-12bar	Controllo temperatura serpentino <i>Boiler temperature controller</i>	QCFH19-3G	SS990	FG 12 FS 13
0														
		02/11												
		DISEGN												
		VISTO												



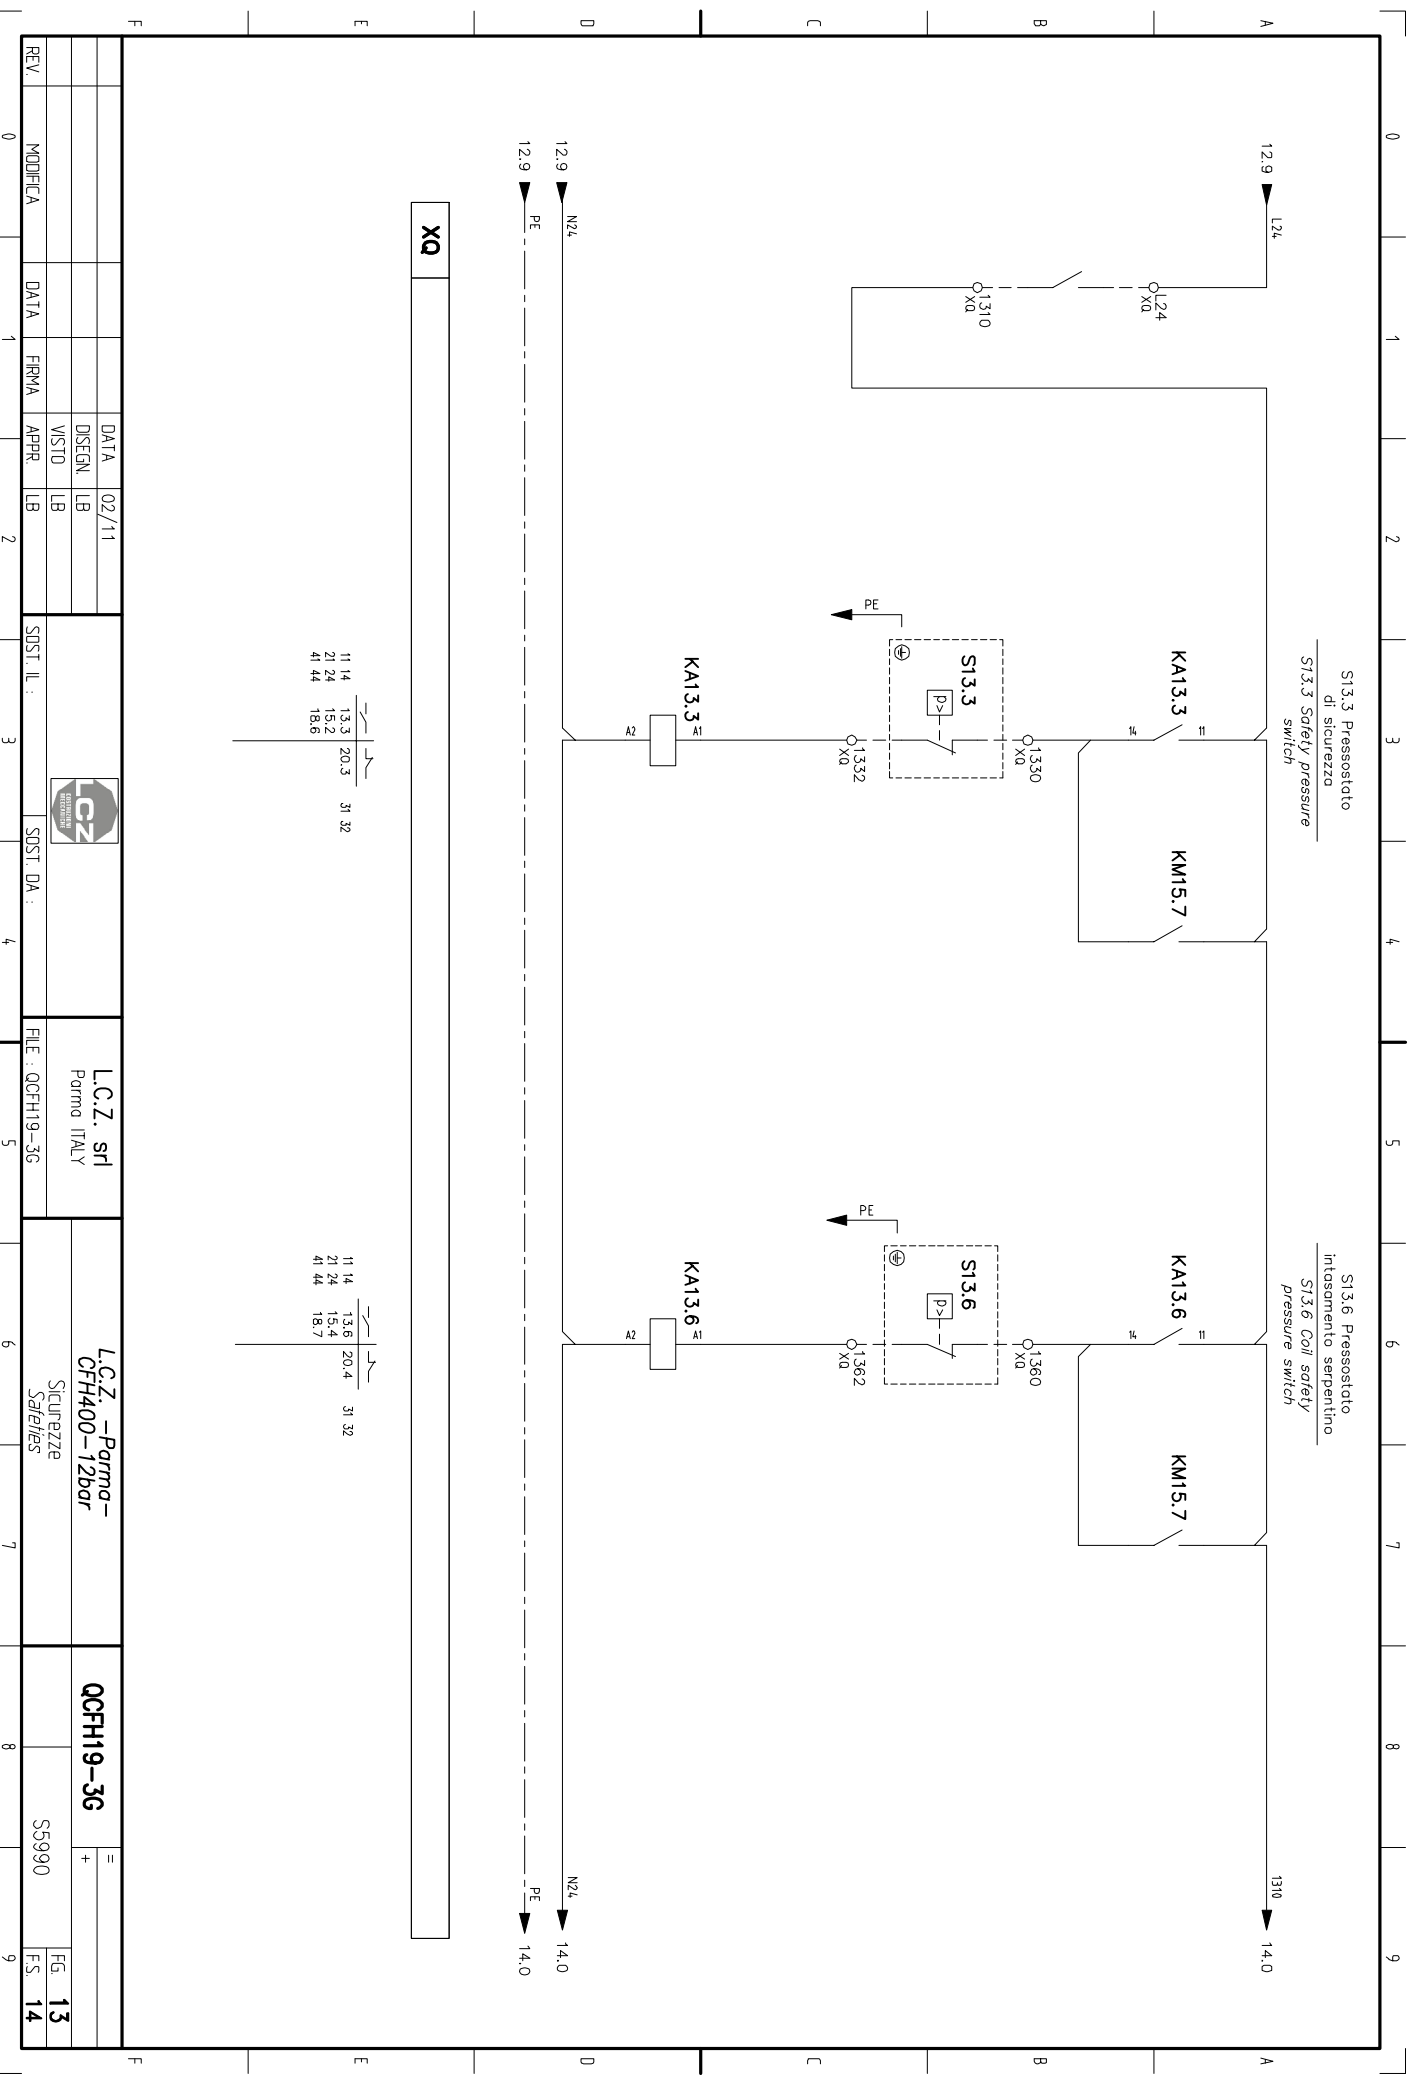

REV.	MODIFICA	DATA	FIRMA	APPR.	LB	SOST. IL :	SOST. DA :	FILE : OCFH19-3G	L.C.Z. srl Parma ITALY	L.C.Z. -Parma- CFH400-12bar Sicurezza Safelias	OCFH19-3G	SS990	FG 13 FS 14
0													
		02/11											

11 14	13 3	20 4	31 32
21 24	15 4		
41 44	18 7		

11 14	13 6	20 4	31 32
21 24	15 4		
41 44	18 7		

